



Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

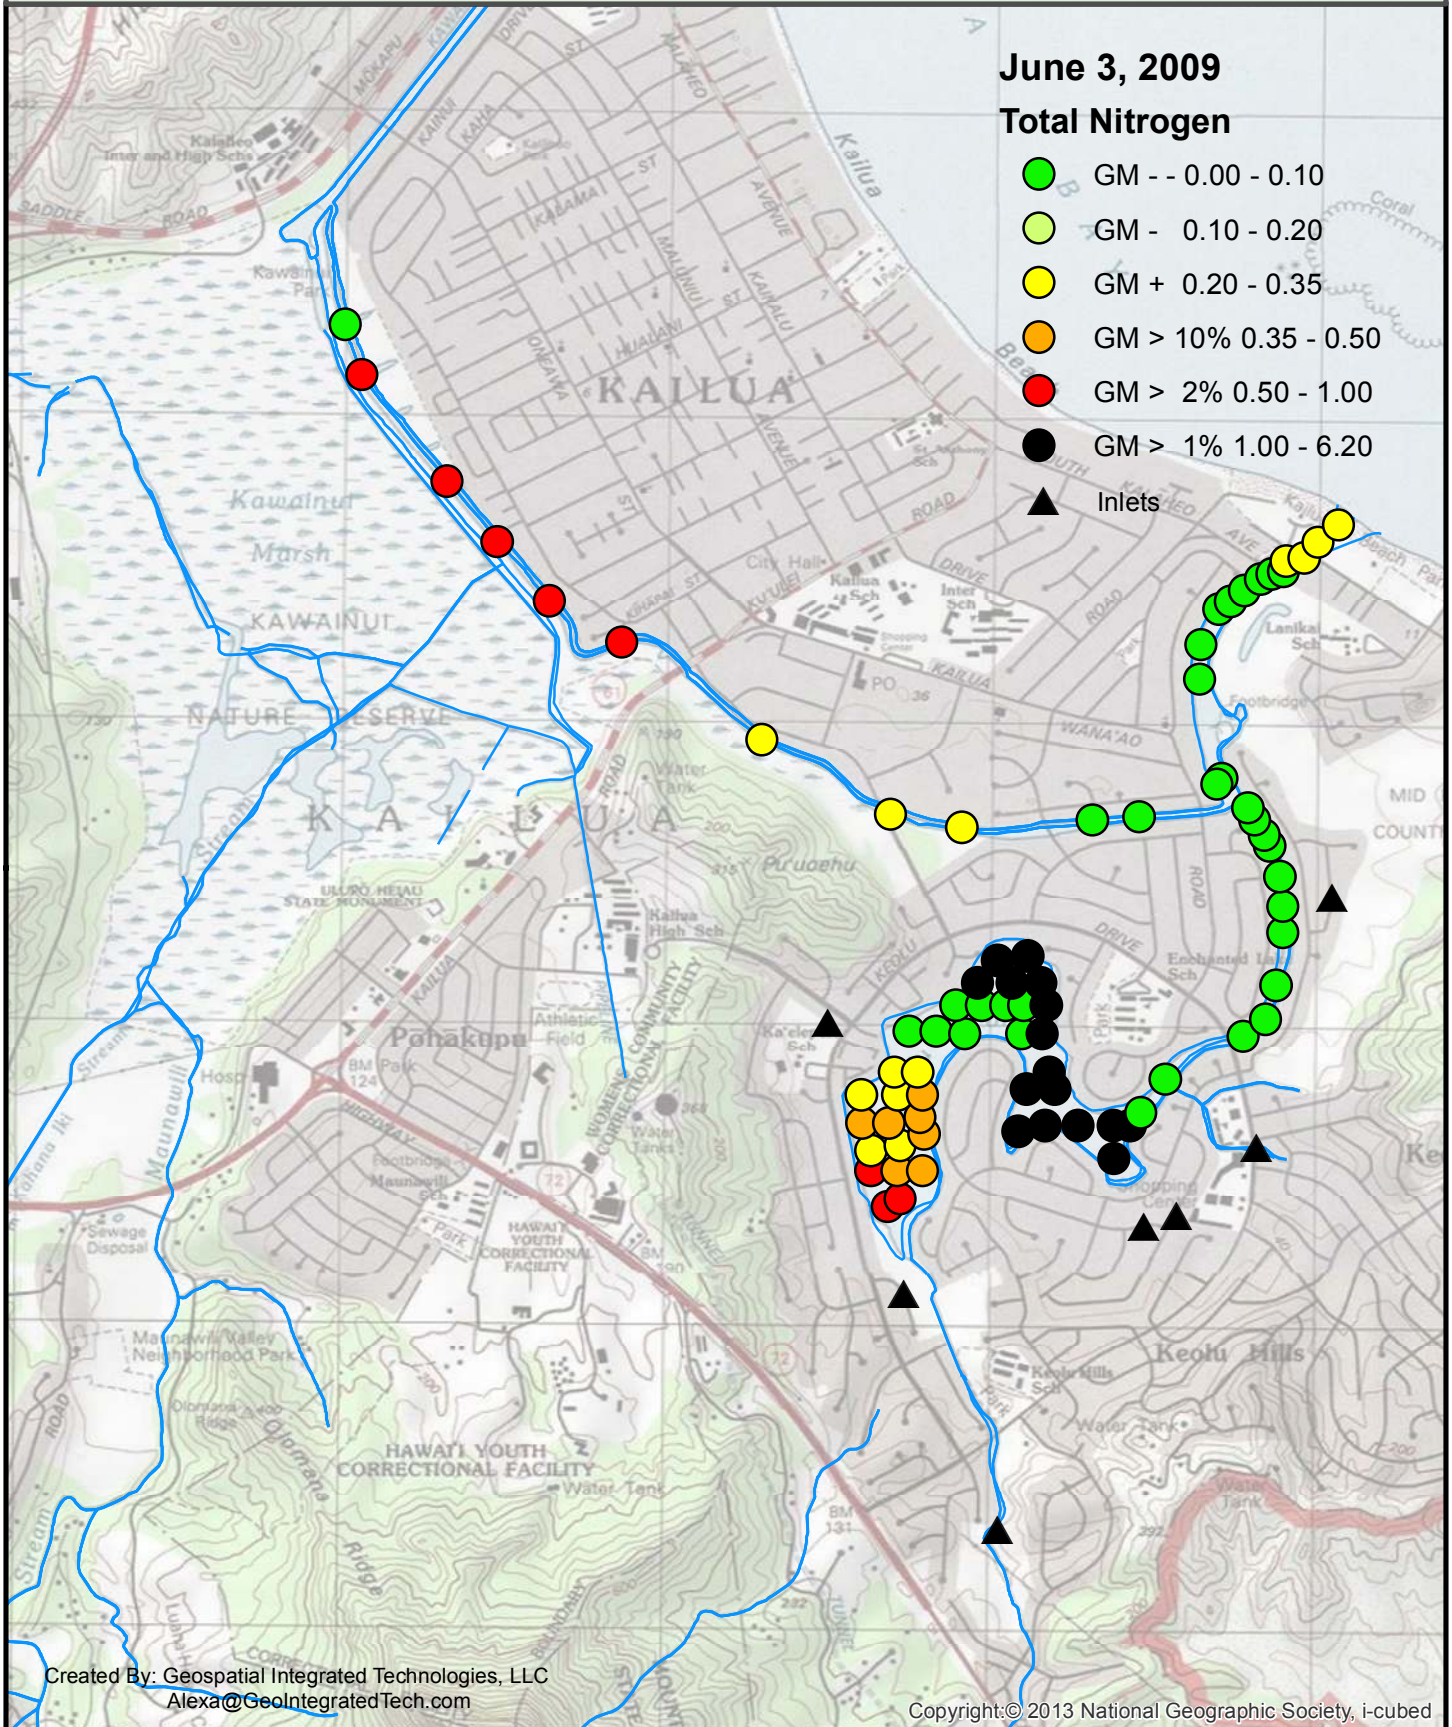


Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

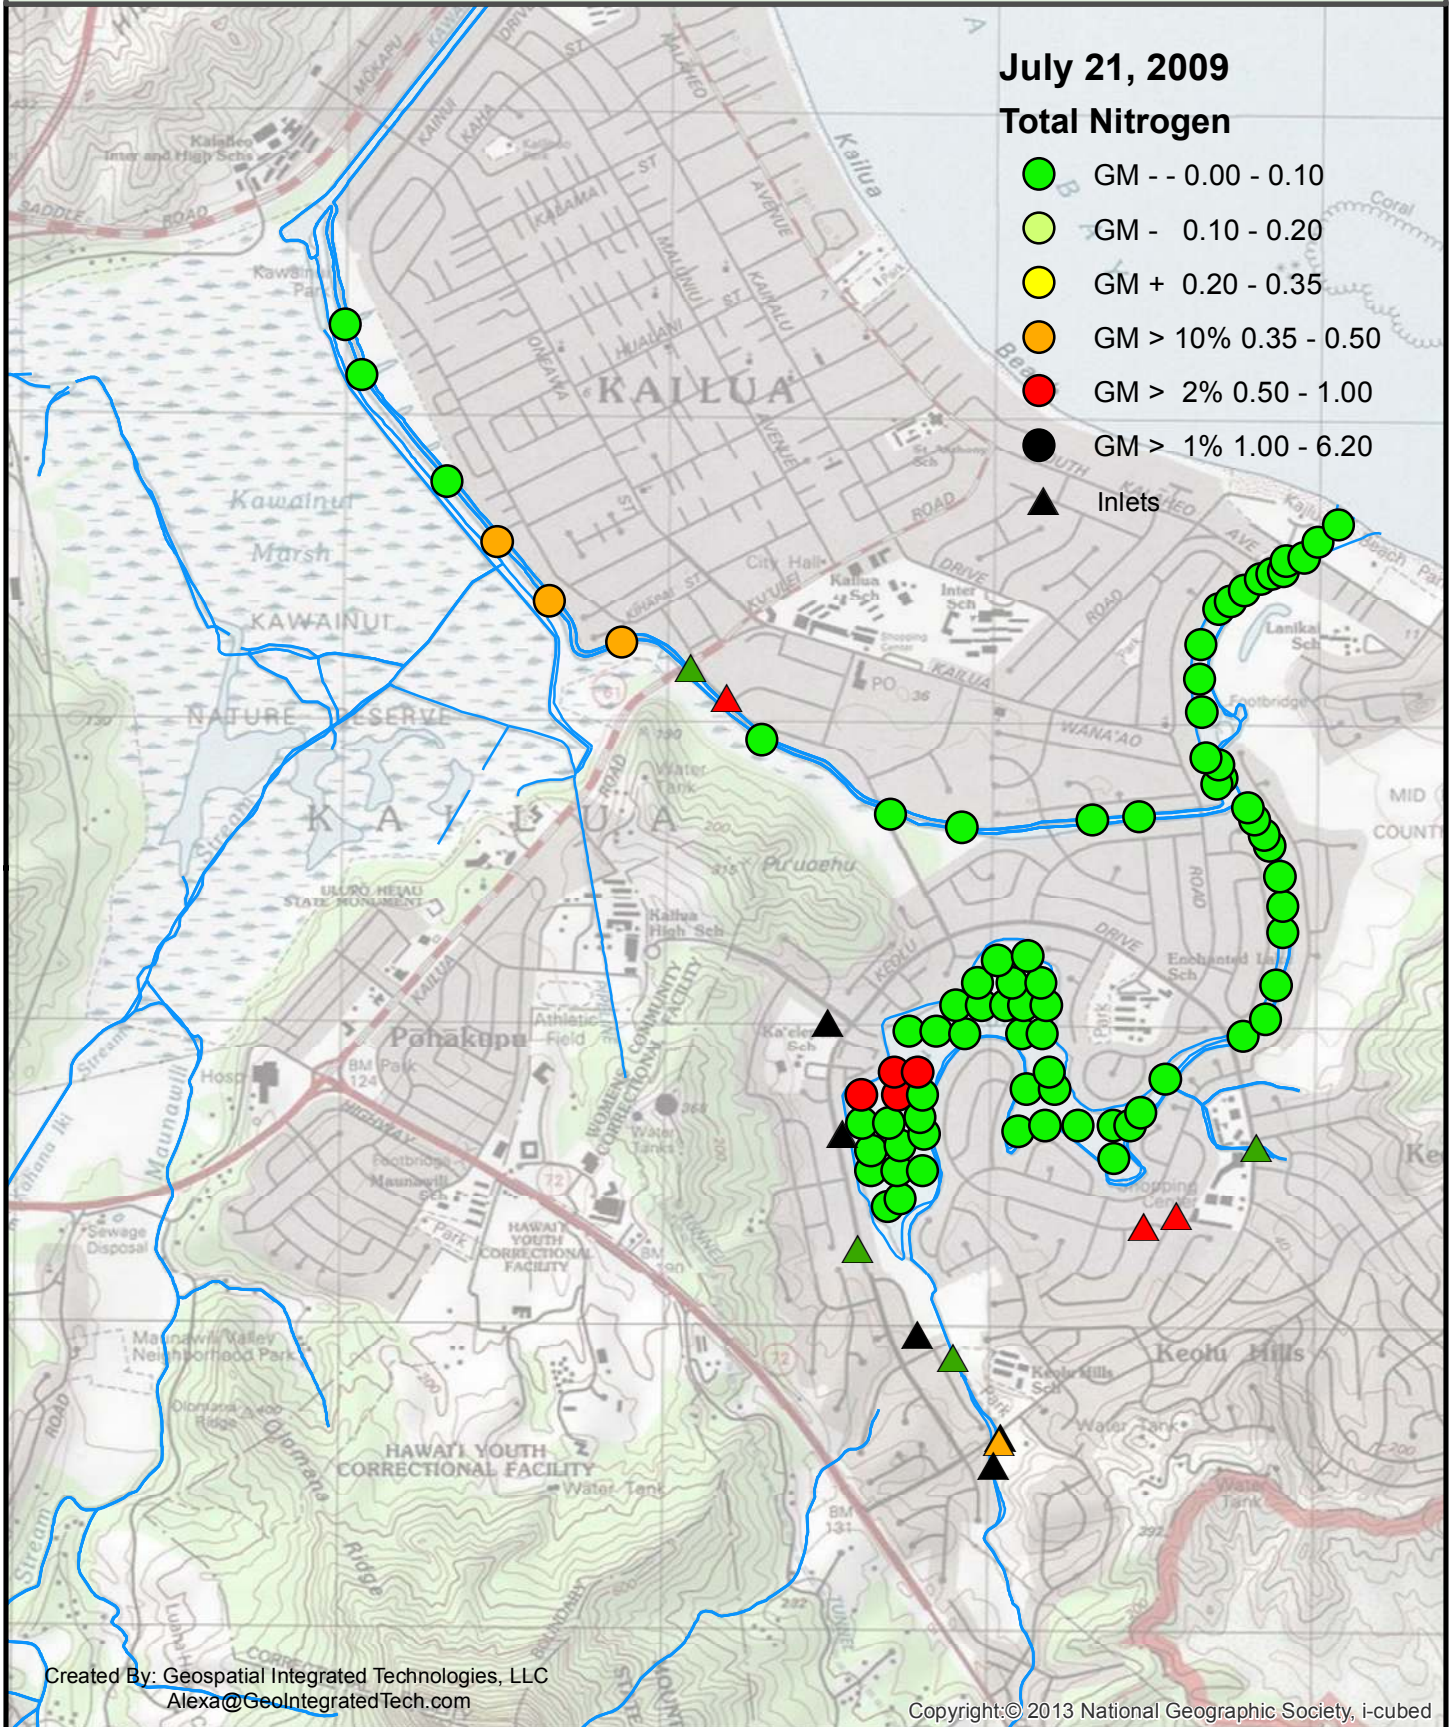


Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

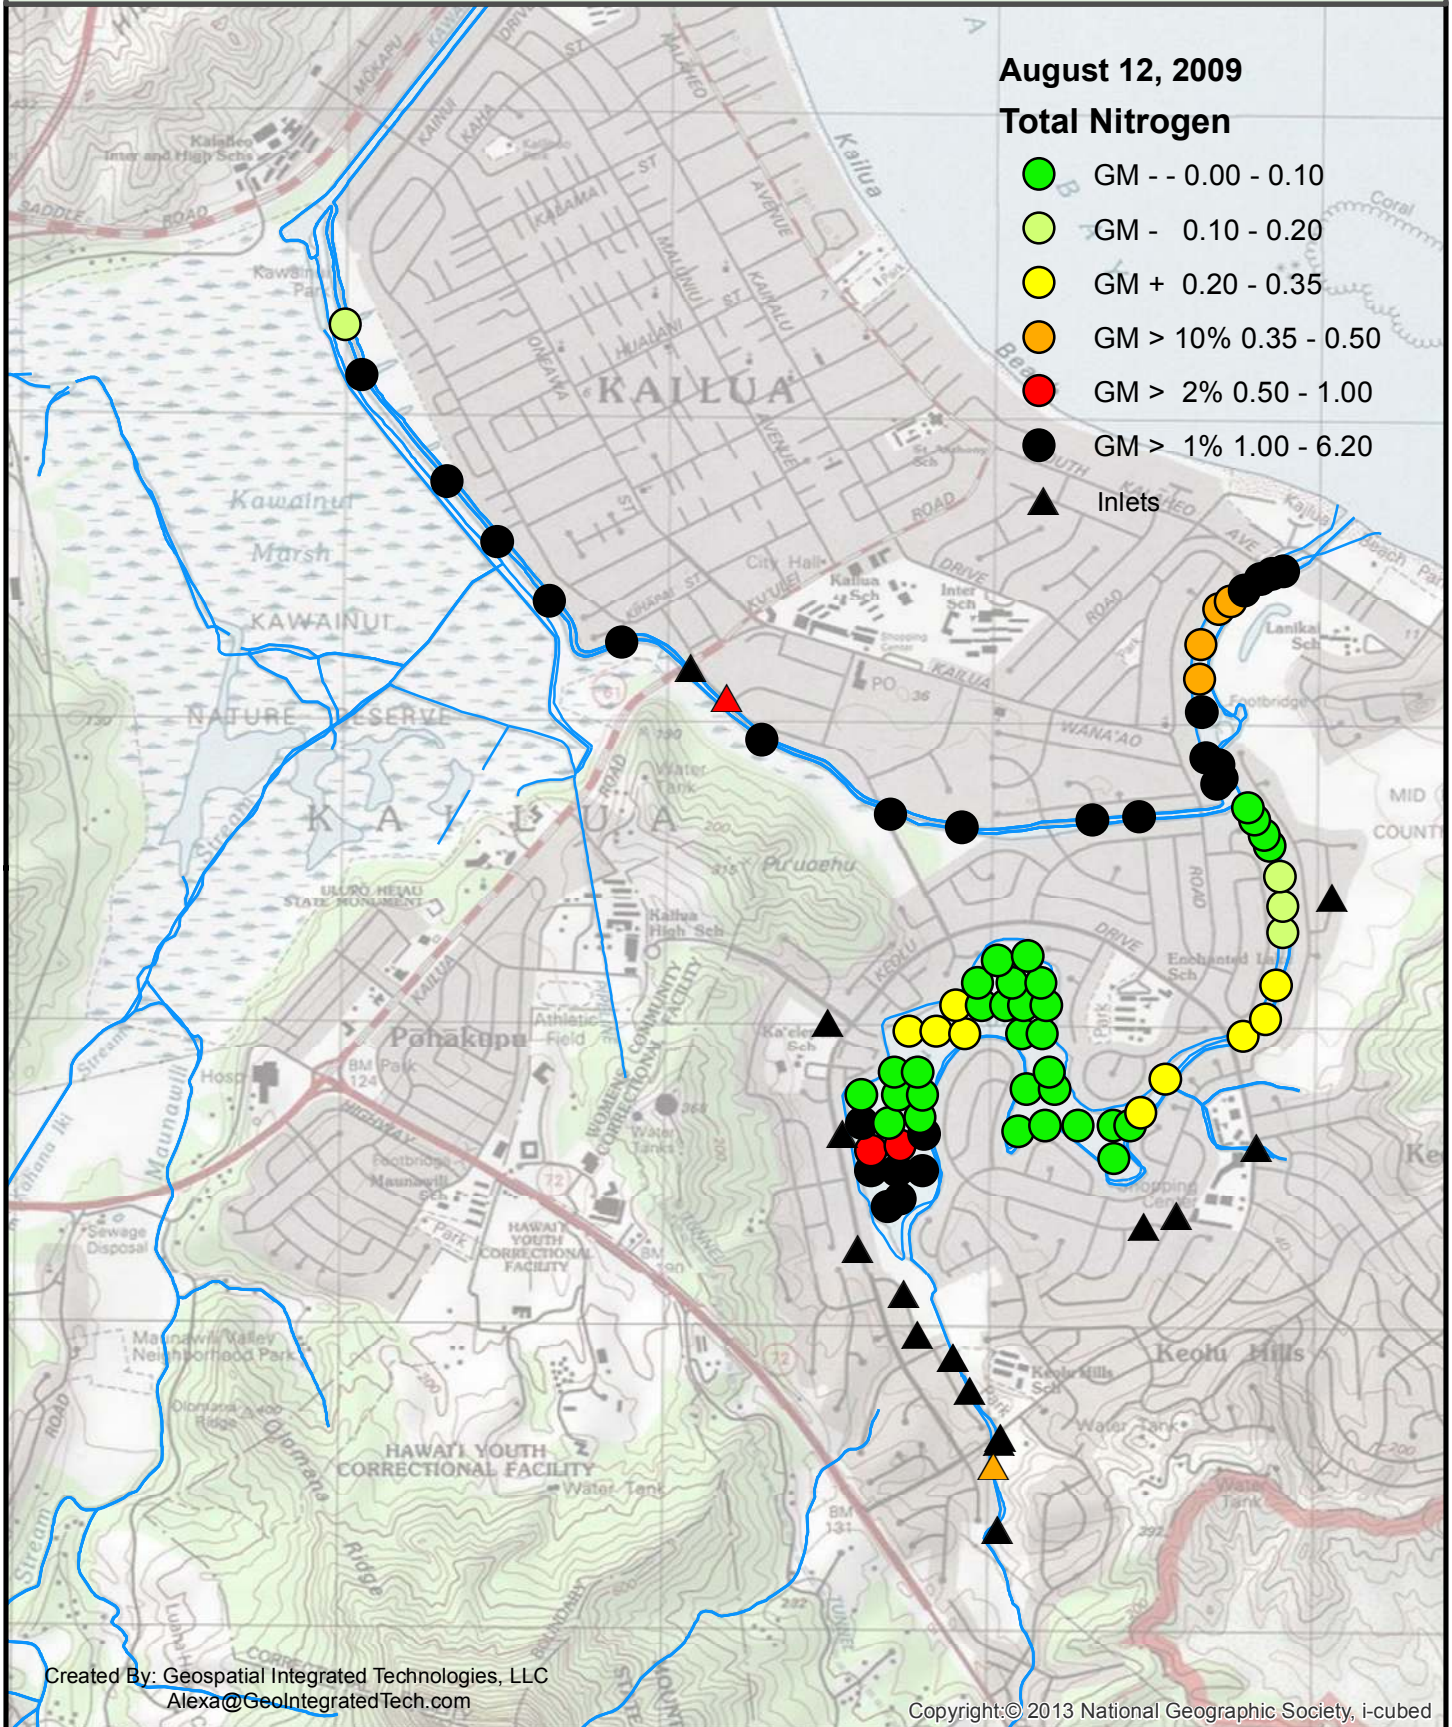


Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

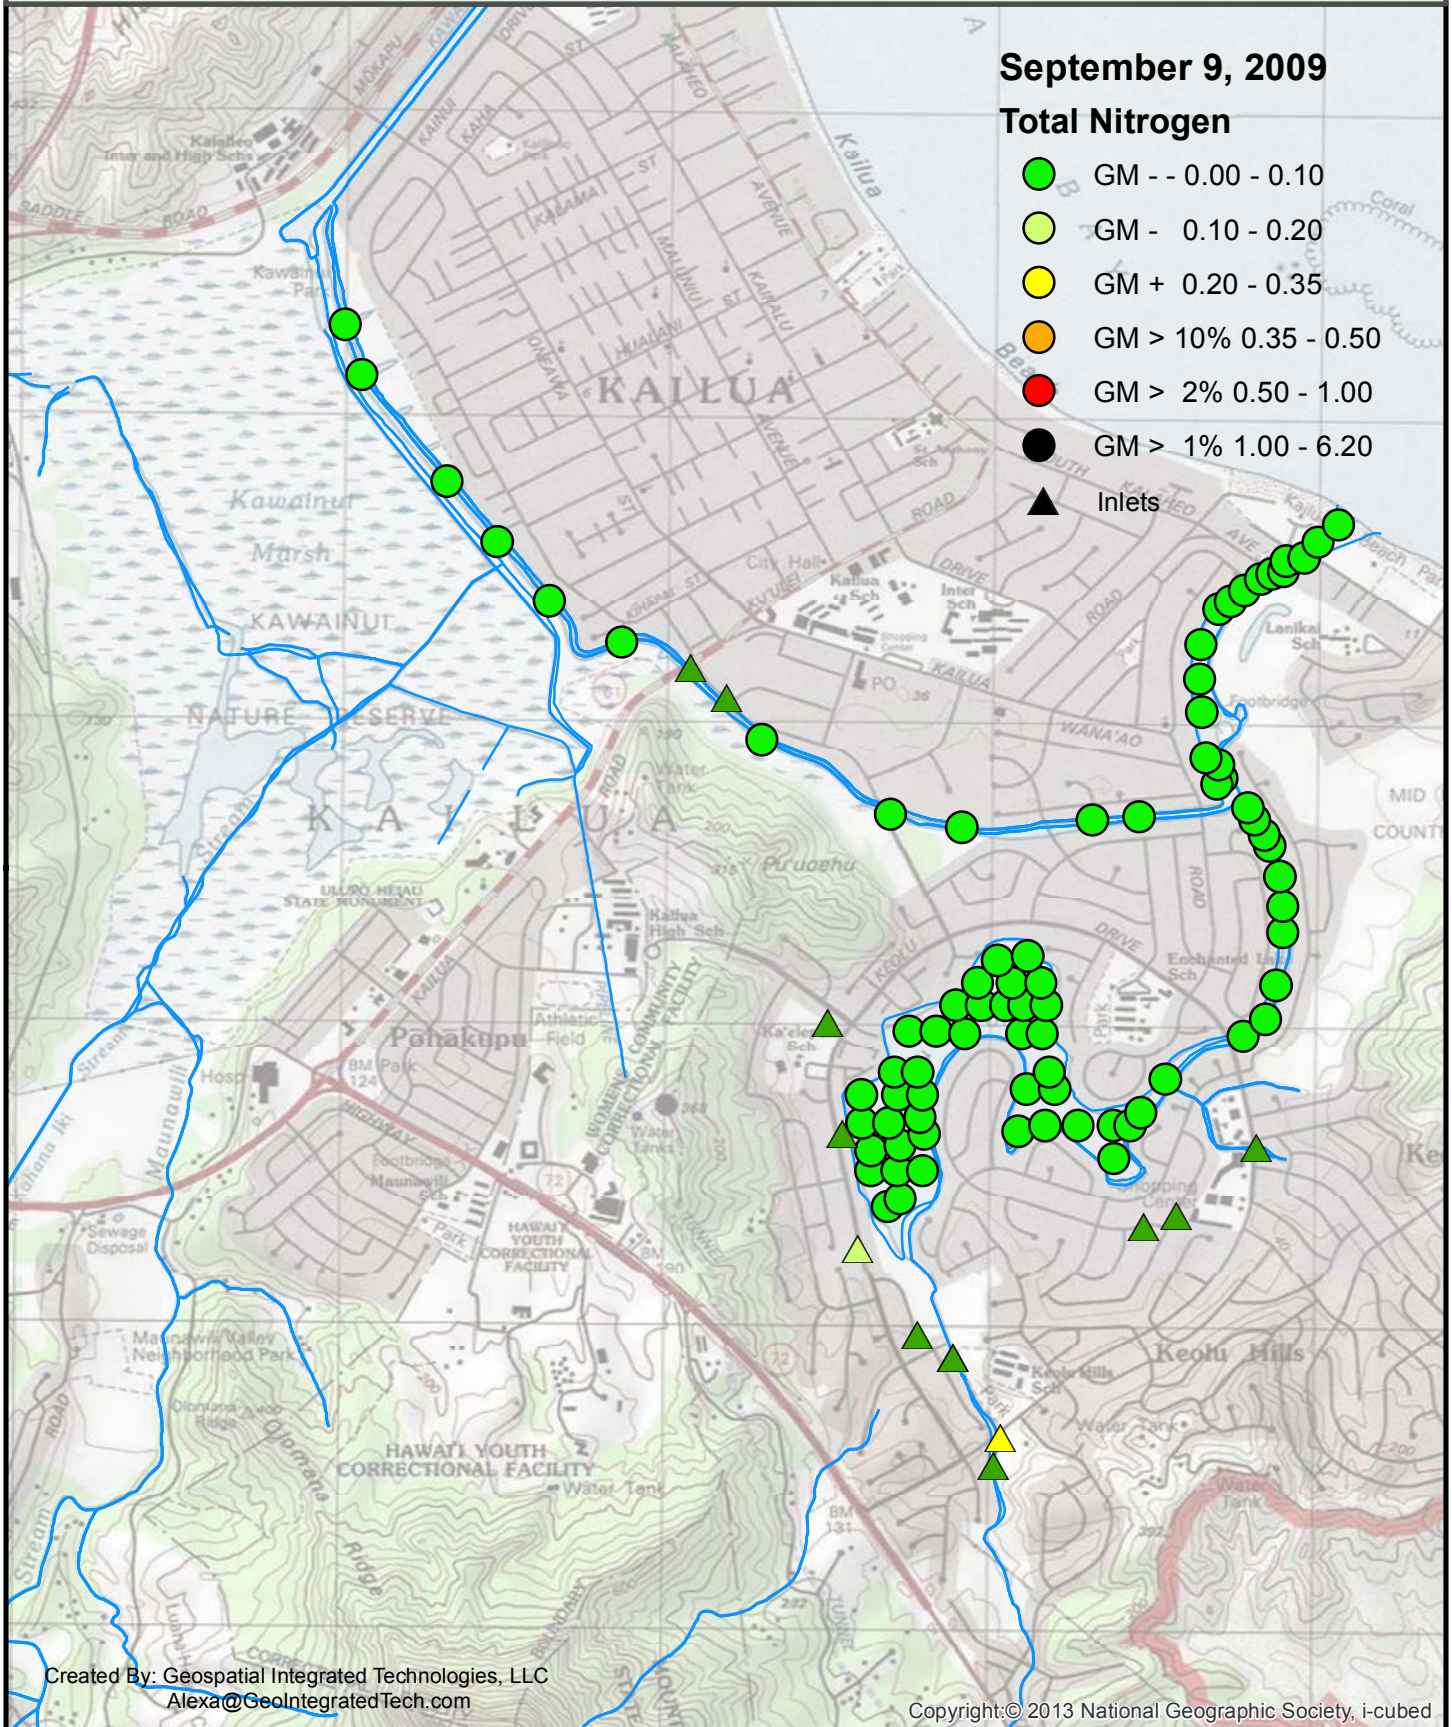

Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

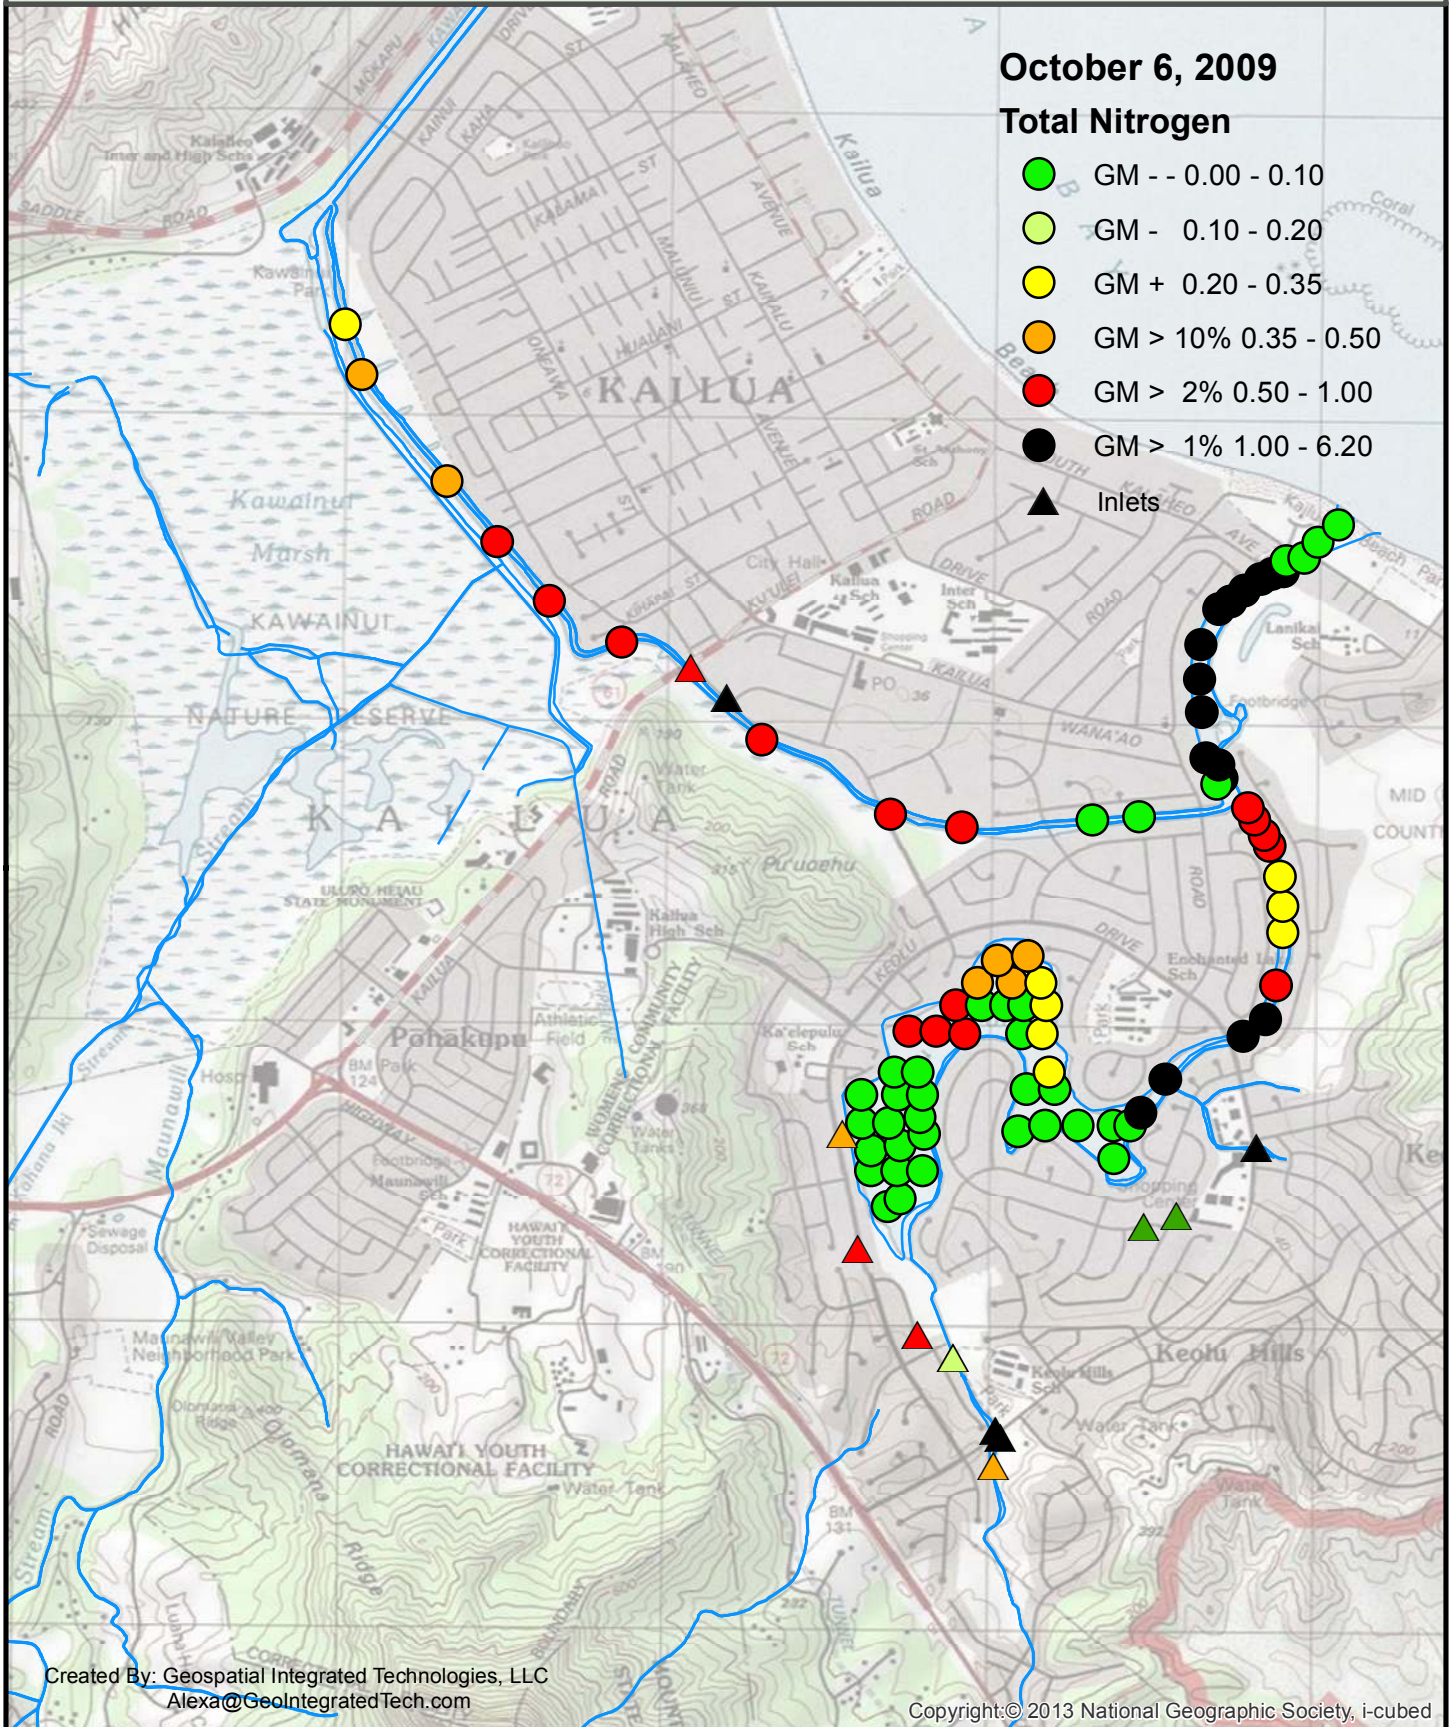


Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

October 26, 2009


Total Nitrogen

- GM -- 0.00 - 0.10
- GM - 0.10 - 0.20
- GM + 0.20 - 0.35
- GM > 10% 0.35 - 0.50
- GM > 2% 0.50 - 1.00
- GM > 1% 1.00 - 6.20
- ▲ Inlets

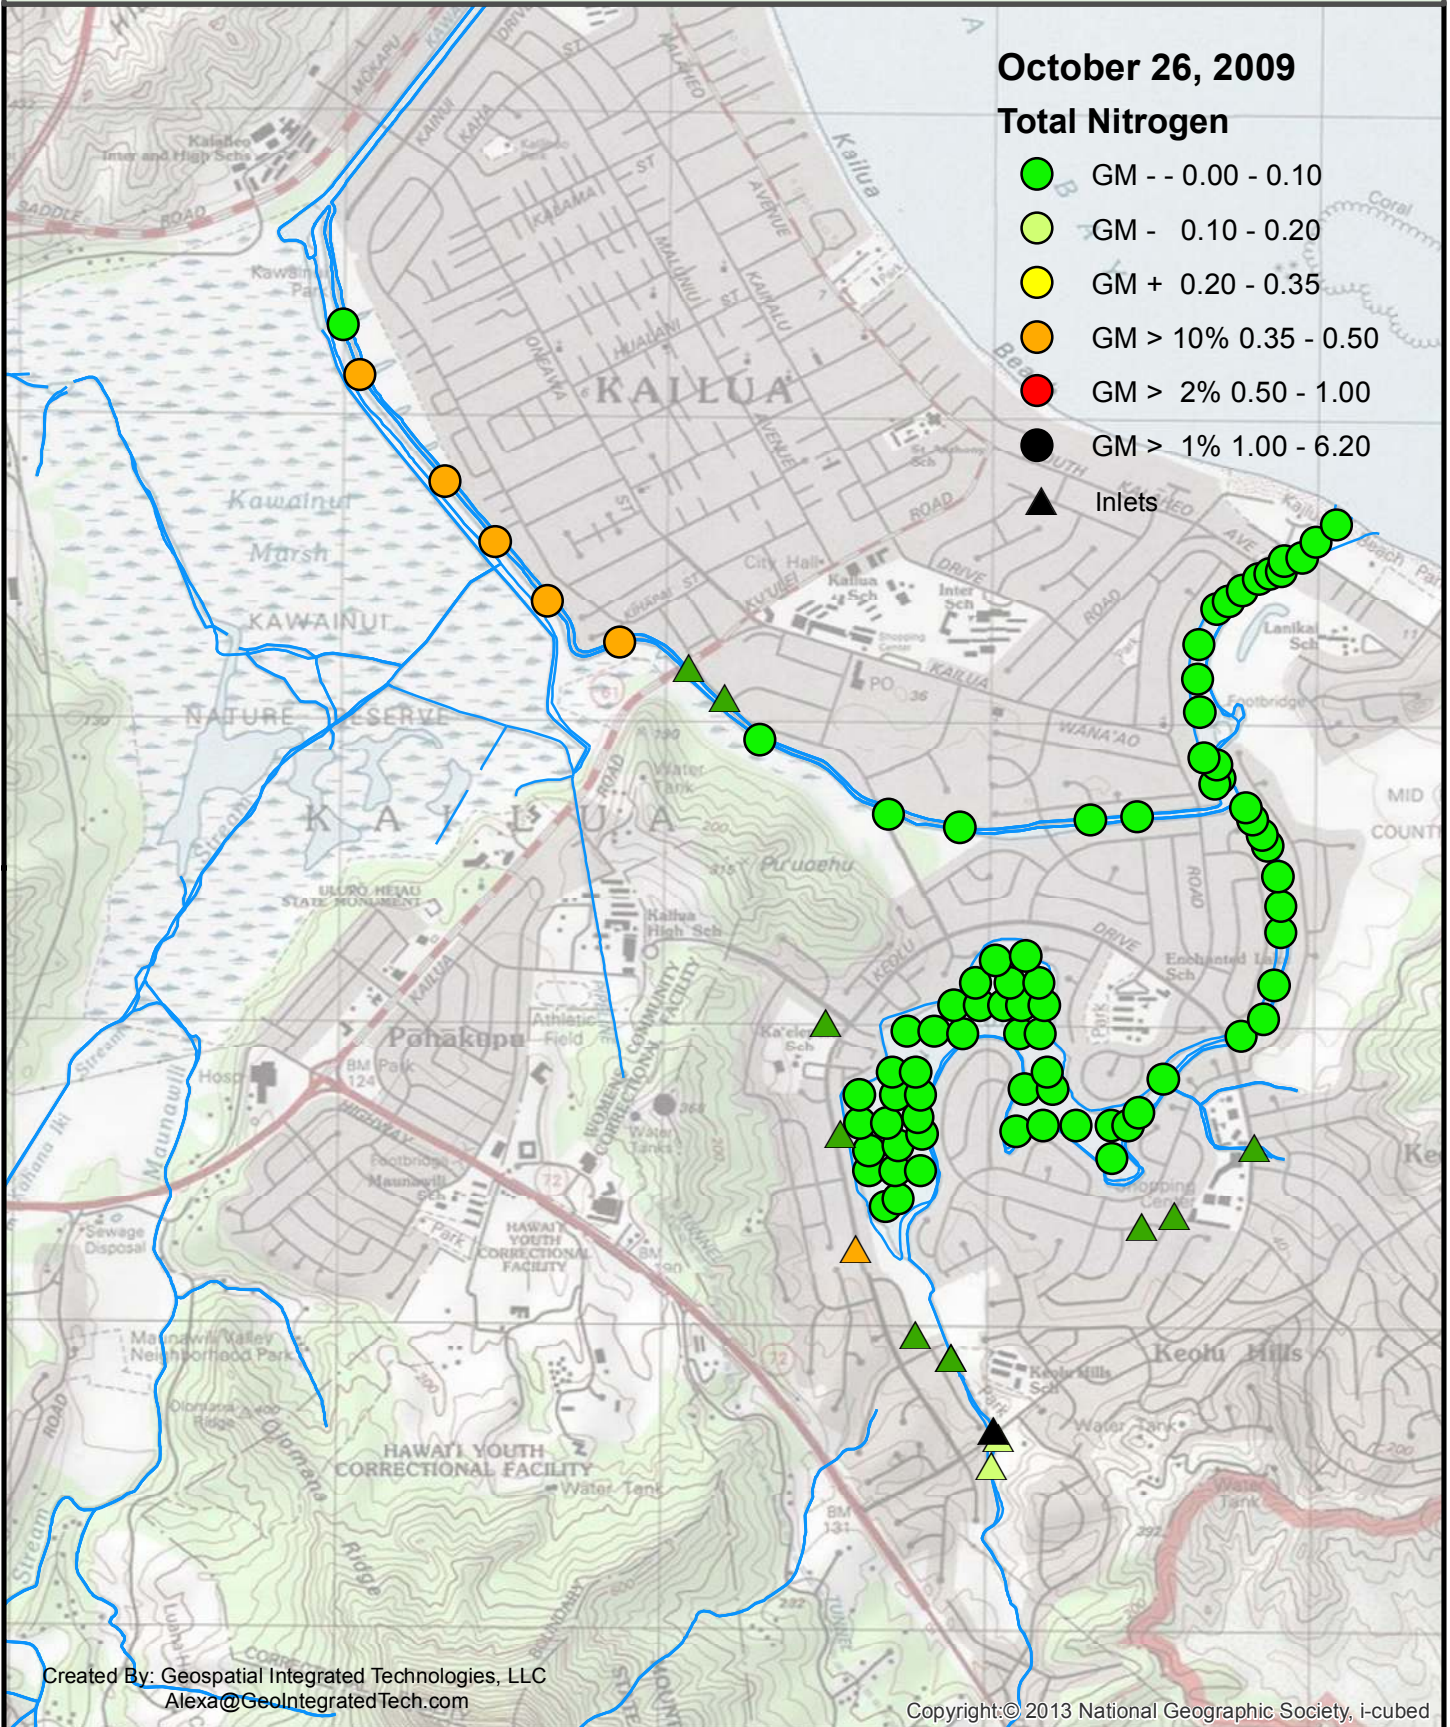

Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

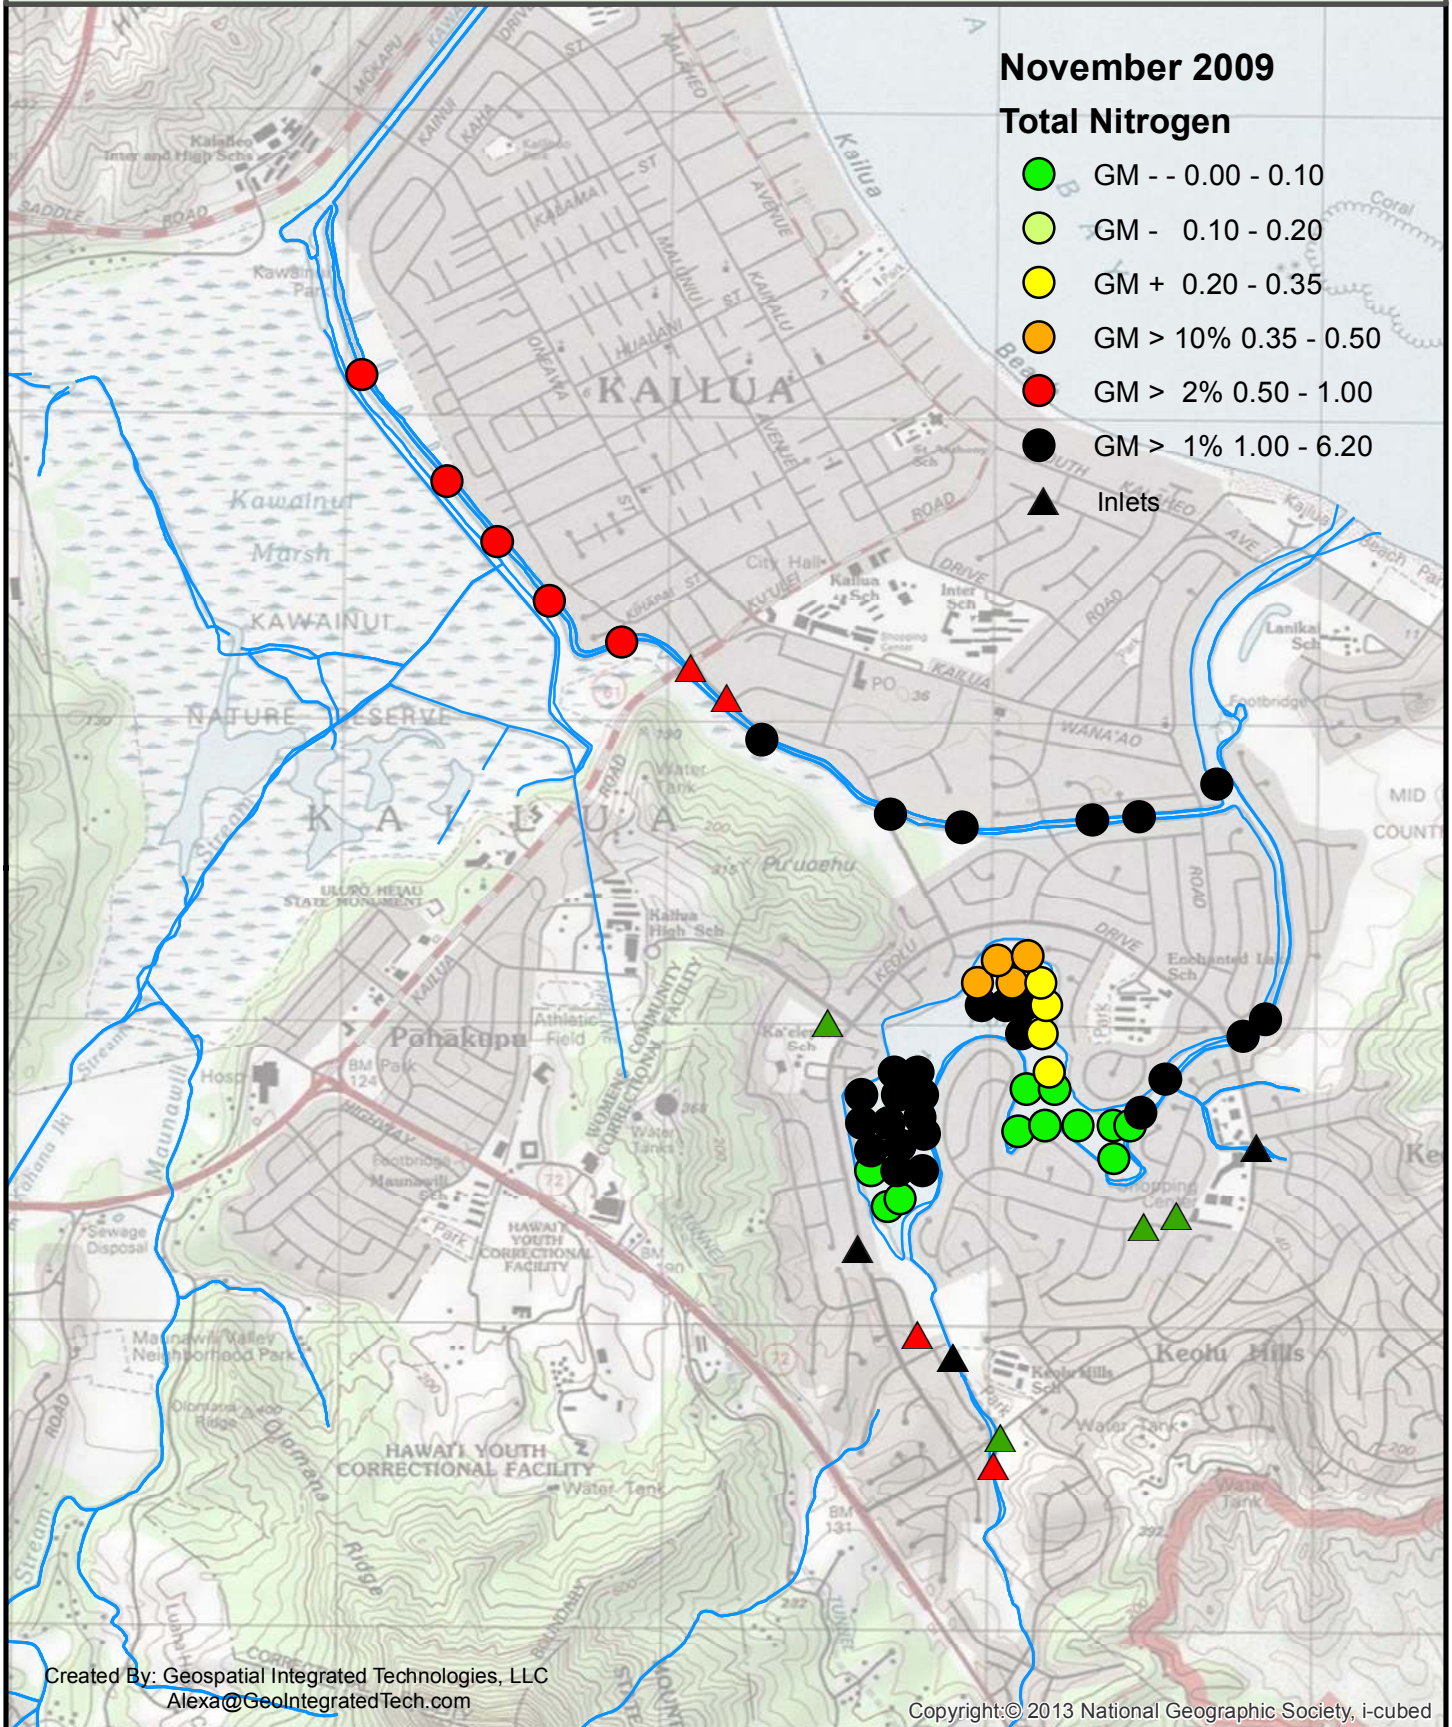

Ka'elepulu Water Quality Kailua, O'ahu, Hawai'i

Nutrient Analysis in Parts Per Million

